| REVISIONS | | | |
|---|---|---|---|
| LETTER | DESCRIPTION | DWG BY | DATE |
| A | REDRAWN AND UPDATED NOTES | JOW3 | 11-30-16 |

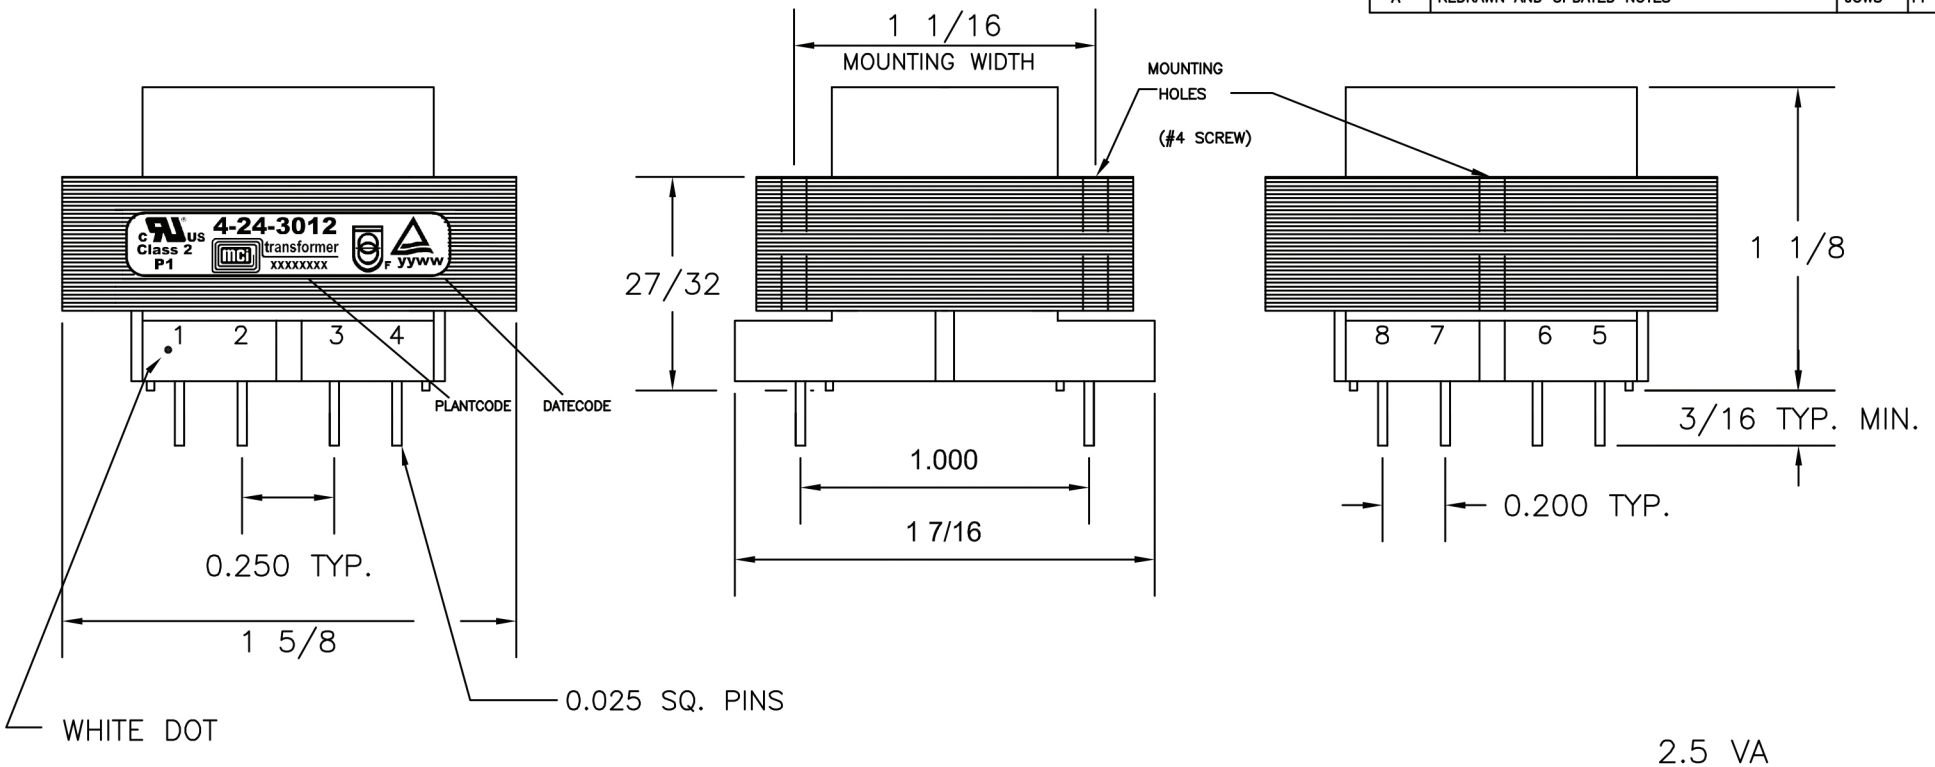


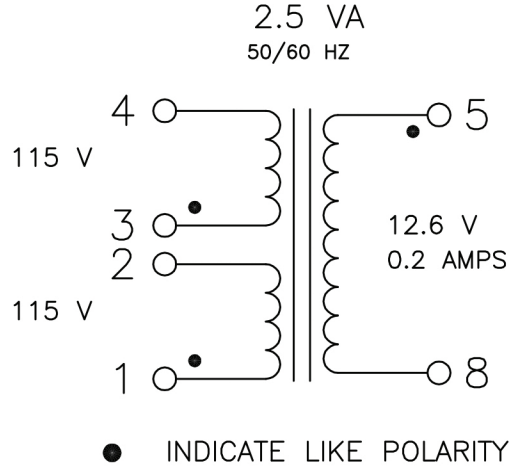


NOTES:

1) UL INSULATION SYSTEM E86543-CLASS F 155°C.
2) UL CLASS 2 RECOGNIZED COMPONENT CERTIFIED TO UL 5085-1, UL 5085-3: FILE # E120827
3) ISOLATION TRANSFORMER CONSTRUCTION UL 60601-1 AND CSA C22.2 NO. 66.1-06, C22.2 NO. 66.3-06, OR C22.2 NO. 0.1-M1985: FILE #E178395
4) TUV CERTIFIED: EN61558-1 AND EN61558-2-6, "IPOO: FAIL-SAFE SAFETY ISOLATION TRANSFORMER."
5) INHERENTLY LIMITED.
6) 4000 VRMS HIPOT BETWEEN PRIMARY AND (SECONDARY + CORE). 600 VOLTS BETWEEN SECONDARY AND CORE.
7) WEIGHT: 0.25 LBS.
8) RoHS AND REACH COMPLIANT
9) ALL DIMENSIONS ARE IN INCHES.

MCI — NORTH BABYLON N.Y.

| | |
|---|---|
| CUSTOMER | MCI |
| TITLE | INTERNATIONAL STYLE PC TRANSFORMER CLASS 2 |

| DRAWN BY | APPRVD BY | SCALE | DATE | DRAWING NUMBER |
|---|---|---|---|---|
| SMS | JOW | NONE | 9-19-14 | 4-24-3012 |