
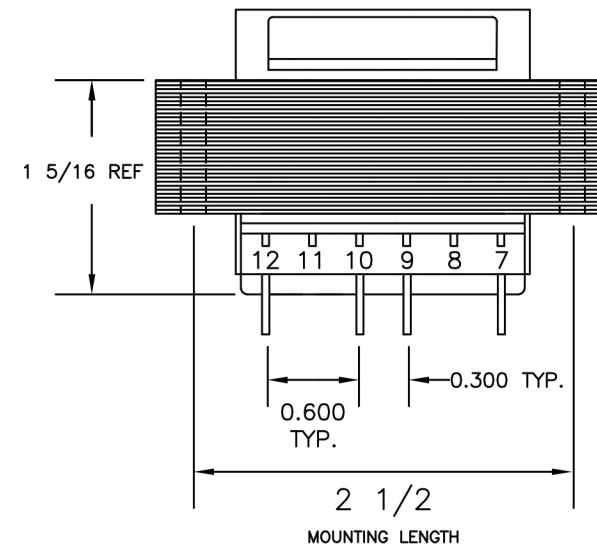



# REVISIONS

LETTER	DESCRIPTION	DWG BY	DATE
A	UPDATED NOTES AND DRAWING	SMS	9-24-14
B	REDRAWN AND UPDATED NOTES	JOW3	11-30-16

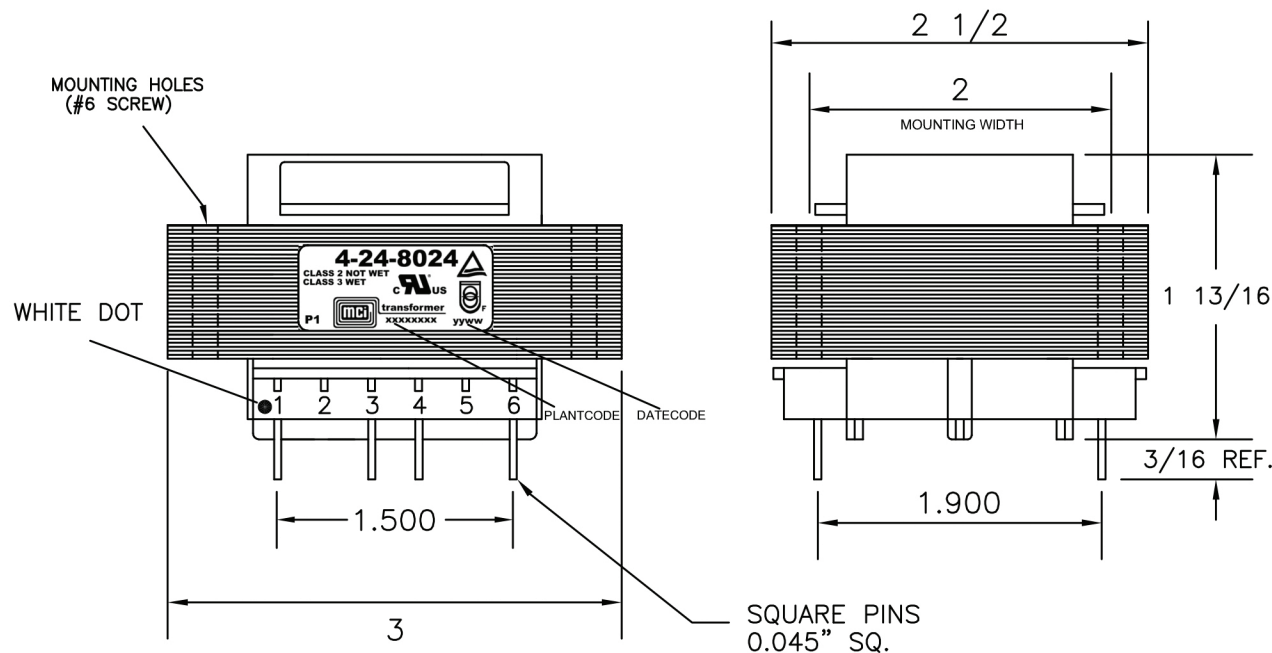

## NOTES:

- 1) UL INSULATION SYSTEM E86543-CLASS F 155°C.
- 2) UL CLASS 2 RECOGNIZED COMPONENT CERTIFIED TO UL 5085-1, UL 5085-3: FILE # E120827
- 3) ISOLATION TRANSFORMER CONSTRUCTION UL 60601-1 AND CSA C22.2 NO. 66.1-06, C22.2 NO. 66.3-06, OR C22.2 NO. 0.1-M1985: FILE #E178395
- 4) TUV CERTIFIED: EN61558-1 AND EN61558-2-6, "IPOO: FAIL-SAFE SAFETY ISOLATION TRANSFORMER"
- \*5) NON-INHERENTLY LIMITED: REQUIRES A 2.5 AMP FUSE ON SECONDARY CIRCUIT FOR CLASS 2 RATING.
- 6) 4000 VRMS HIPOT BETWEEN PRIMARY AND (SECONDARY + CORE). 600 VOLTS BETWEEN SECONDARY AND CORE.
- 7) WEIGHT: 1.70 LBS.
- 8) RoHS AND REACH COMPLIANT
- 9) ALL DIMENSIONS ARE IN INCHES.

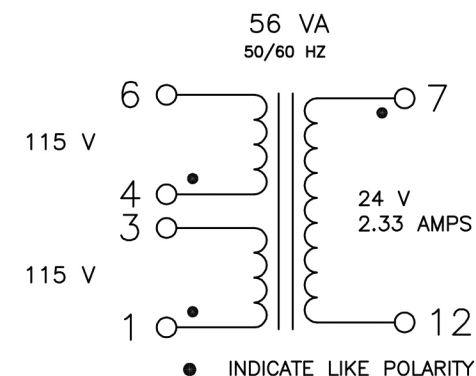

MCI NORTH BABYLON N.Y.				
CUSTOMER MCI				
TITLE VDE PC CLASS 2 TRANSFORMER				
DRAWN BY SMS	APPRVD BY JOW	SCALE NONE	DATE 11-26-13	DRAWING NUMBER 4-24-8024