



REVISIONS

| LETTER | DESCRIPTION | DWG BY | DATE |
|--------|--|--------|---------|
| A | UPDATED DRAWING NOTES AND ADDED DIMENSIONS | SMS | 8-22-14 |
| B | REDRAWN AND UPDATED NOTES | SMS | 1-20-17 |

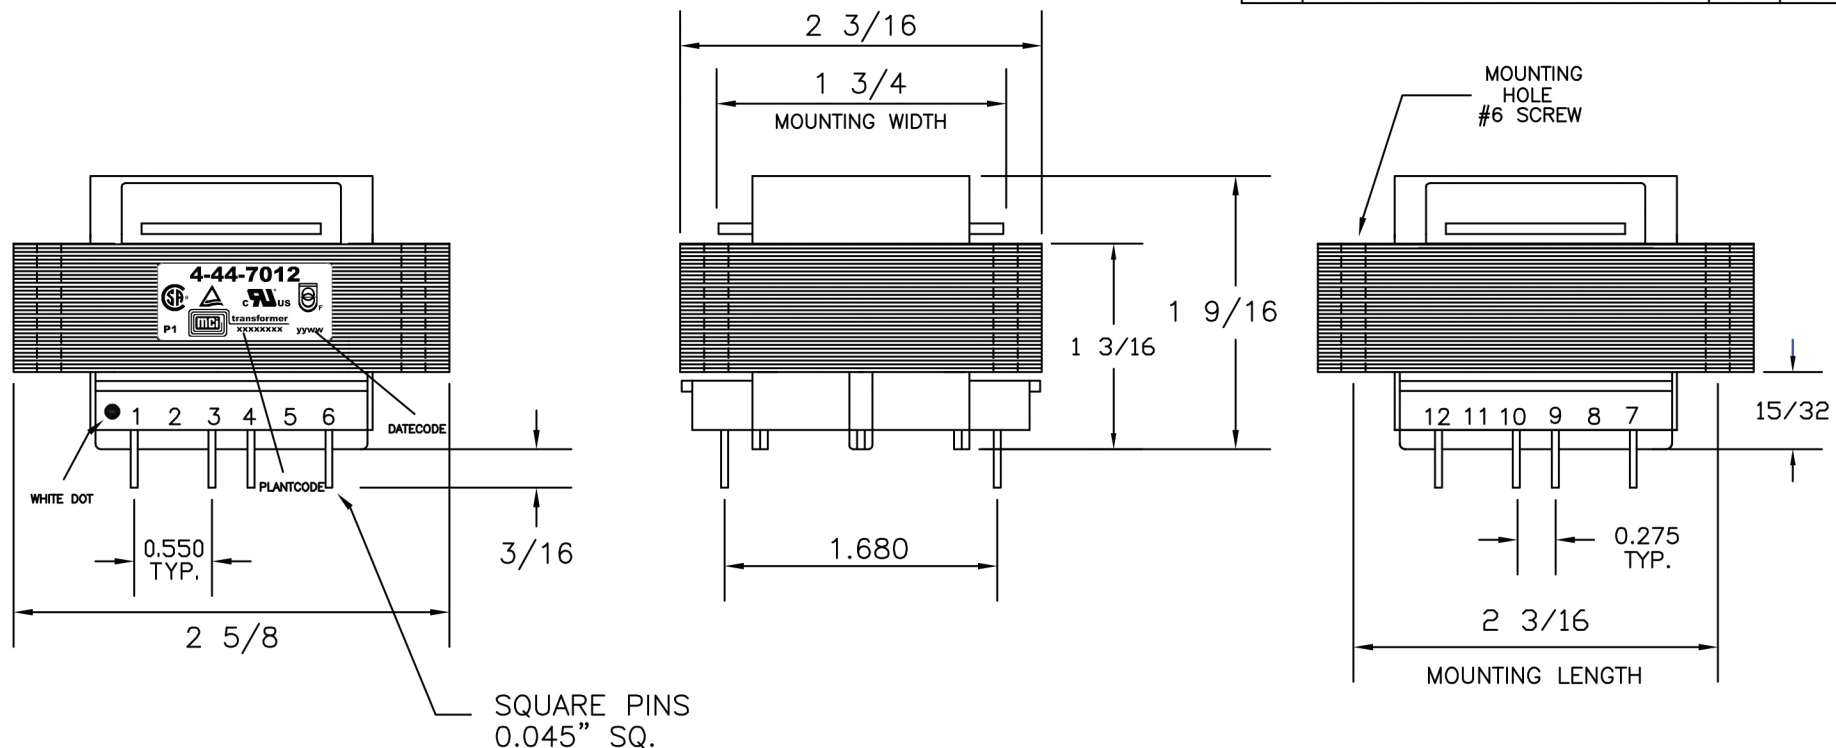

NOTES:

- 1) UL INSULATION SYSTEM E86543-CLASS F 155°C.
- 2) UL RECOGNIZED COMPONENT: FILE # E86403
- 3) ISOLATION TRANSFORMER CONSTRUCTION UL 60601-1 AND CSA C22.2 NO. 601.1-M90: FILE #E178395
- 4) TUV CERTIFIED: EN61558-1 AND EN61558-2-6, "IPOO: FAIL-SAFE SAFETY ISOLATION TRANSFORMER"
- 5) CSA CERTIFIED: FILE # LR80864
- 6) 4000 VRMS HIPOT BETWEEN PRIMARY AND (SECONDARY + CORE).
500 VOLTS BETWEEN SECONDARY AND CORE.
- 7) WEIGHT: 1.15 LBS.
- 8) RoHS AND REACH COMPLIANT
- 9) ALL DIMENSIONS ARE IN INCHES.

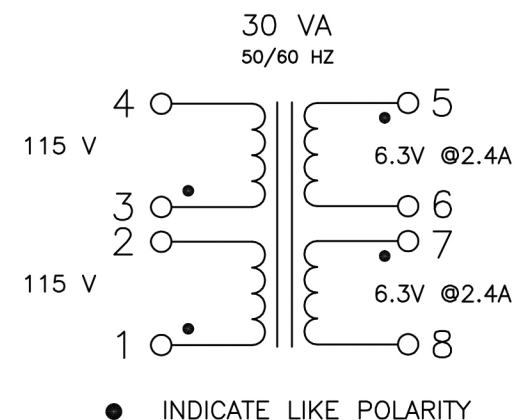

| MCI | | | | | NORTH BABYLON N.Y. |
|----------|-----------|-------|--------|----------------|------------------------------------|
| CUSTOMER | | | | | MCI |
| TITLE | | | | | INTERNATIONAL STYLE PC TRANSFORMER |
| DRAWN BY | APPRVD BY | SCALE | DATE | DRAWING NUMBER | |
| SMS | JOW | NONE | 6-6-12 | 4-44-7012 | |