
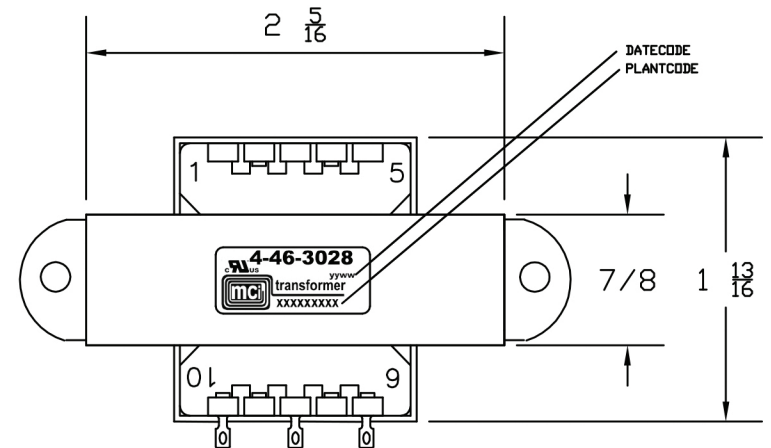
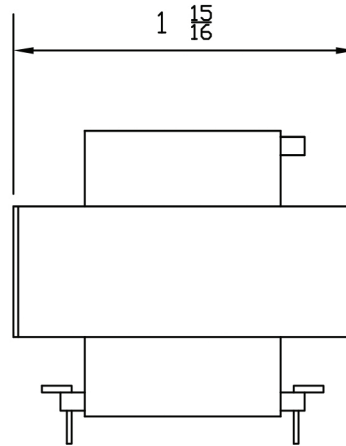



REVISIONS

| LETTER | DESCRIPTION | DATE |
|--------|-------------|------|
| | | |

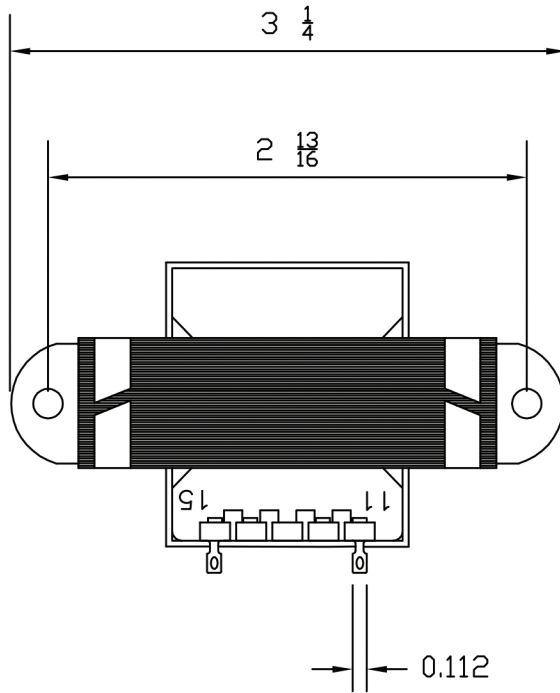

NOTES:

- 1) UL RECOGNIZED COMPONENT: STANDARD XPTQ2, FILE E86403
- 2) UL CERTIFIED FOR CANADA-COMPONENT: STANDARD XPTQ8, FILE E86403
- 3) WEIGHT: 0.97 LBS.
- 4) RoHS AND REACH COMPLIANT
- 5) ALL DIMENSIONS ARE IN INCHES
- 6) 4000 VOLT HIPOT BETWEEN PRIMARY AND (SECONDARY AND CORE)
500 VOLT HIPOT FROM SECONDARY TO CORE

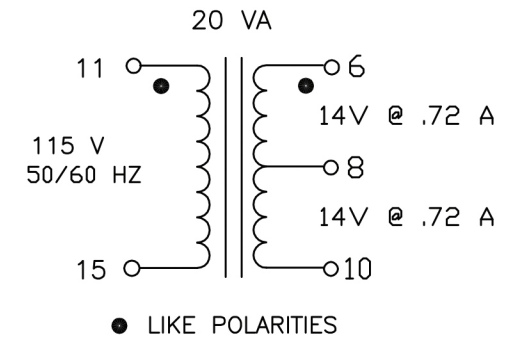

| | | | | | |
|------------|-----------|-------|---------|----------------|-------------------------------|
| MCI | | | | | NORTH BABYLON N.Y. |
| CUSTOMER | | | | | MCI |
| TITLE | | | | | VDE QUICK CONNECT TRANSFORMER |
| DRAWN BY | APPRVD BY | SCALE | DATE | DRAWING NUMBER | |
| SMS | JOW | NONE | 1-16-17 | 4-46-3028 | |